


COPYRIGHT © 2016 SOUTHGATE WATER & SANITATION DISTRICTS

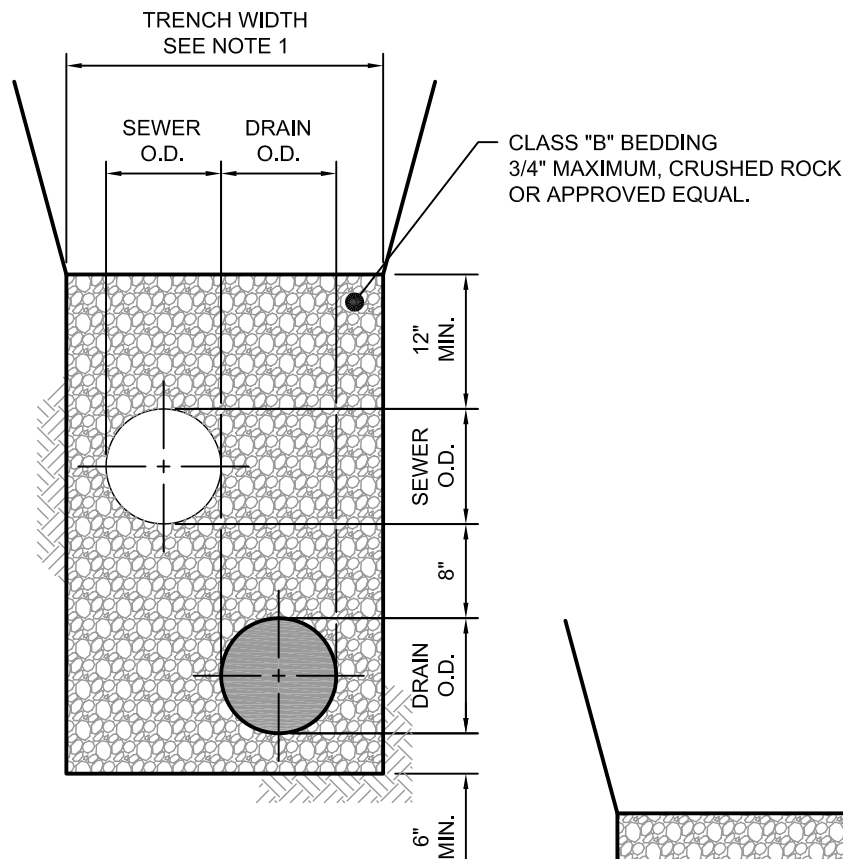

**TYPICAL MAIN LINE TRENCH
W/ CLOSED PIPE UNDERDRAIN**


NOTE:
TO BE USED IN CONJUNCTION WITH
STANDARD BEDDING DETAIL FOR TRENCH,
BEDDING AND COMPACTION REQUIREMENTS.

SINGLE LAYER 8 MIL.
POLYETHYLENE PLASTIC

ALTERNATE LOCATION
OF POLYETHYLENE PLASTIC

**ALTERNATIVE MAIN LINE TRENCH WITH
CLOSED OR OPEN PIPE UNDERDRAIN**

NOTE:
TO BE USED IN CONJUNCTION WITH
STANDARD BEDDING DETAIL FOR TRENCH,
BEDDING AND COMPACTION REQUIREMENTS.

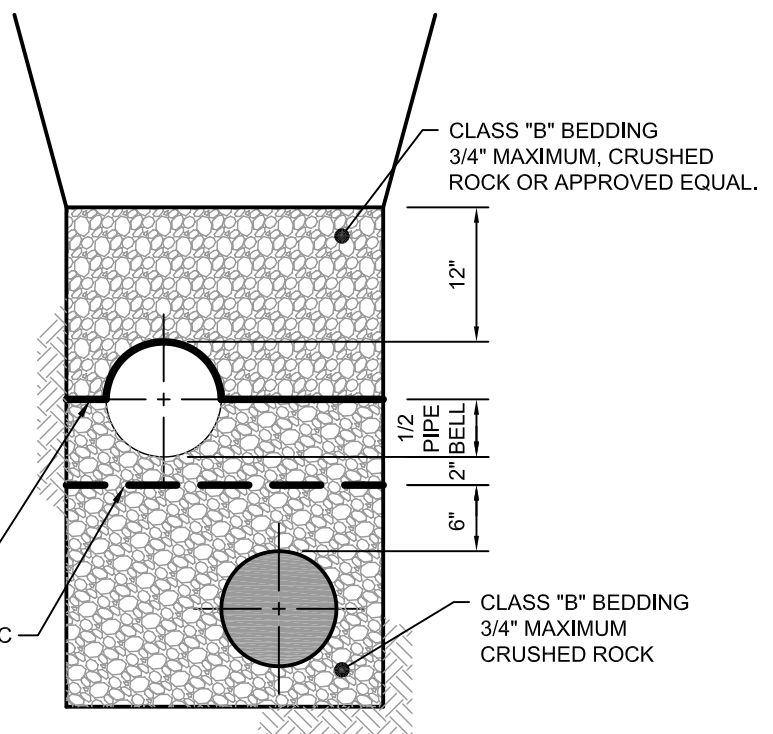

REVISED	
BY	DATE



Southgate
WATER & SANITATION DISTRICTS

**SANITARY SEWER TRENCH WITH
PRIVATELY OWNED UNDERDRAIN**

SCALE	
NOT TO SCALE	
ISSUE DATE	
FEBRUARY 2016	
SHEET	DRAWING NO.
1 OF 1	SS-29